

FIG. 1A

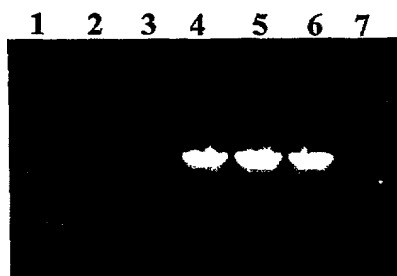


FIG. 1B

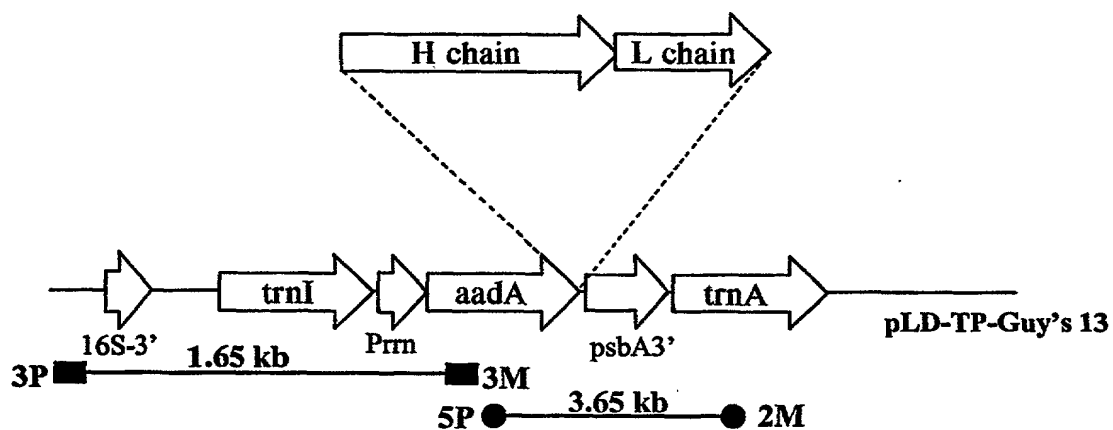
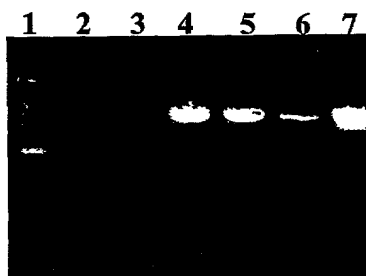


FIG. 1C

FIG. 2A

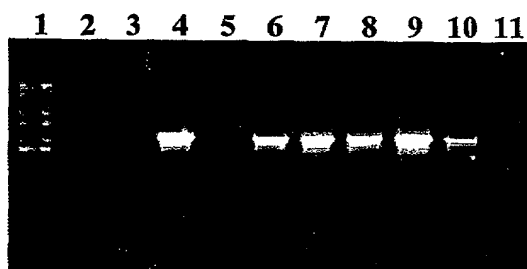


FIG. 2B



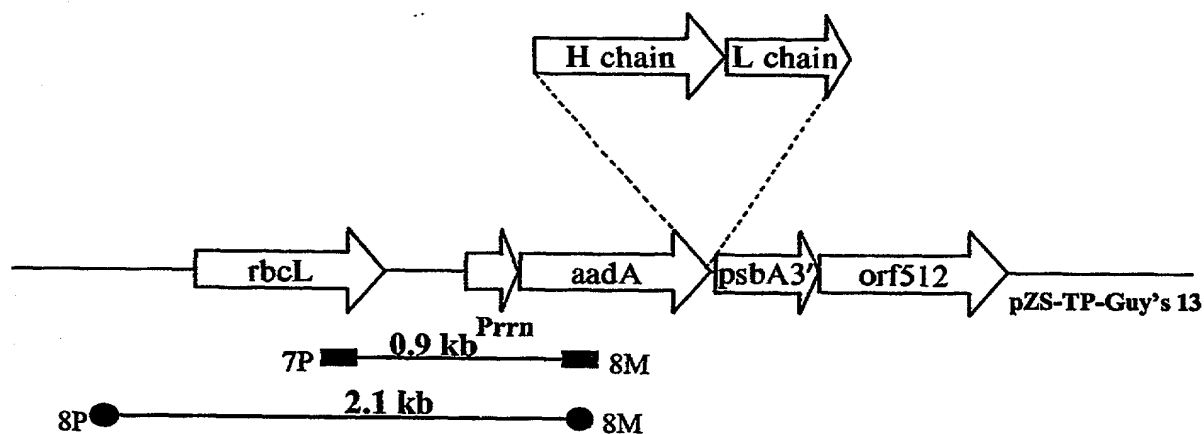



FIG. 2C

3/8

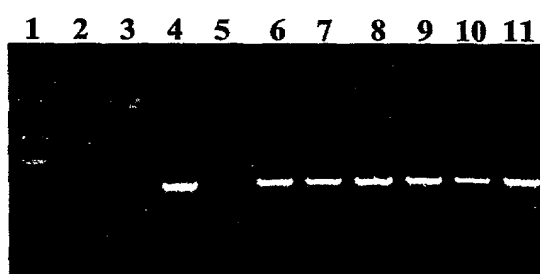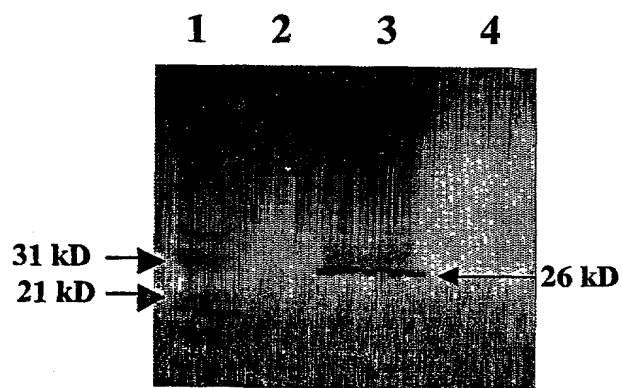


Sonicated samples

FIG. 3A

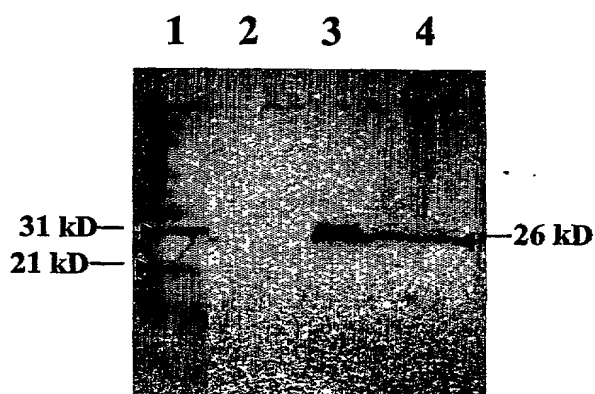


Sonicated samples

FIG. 3B

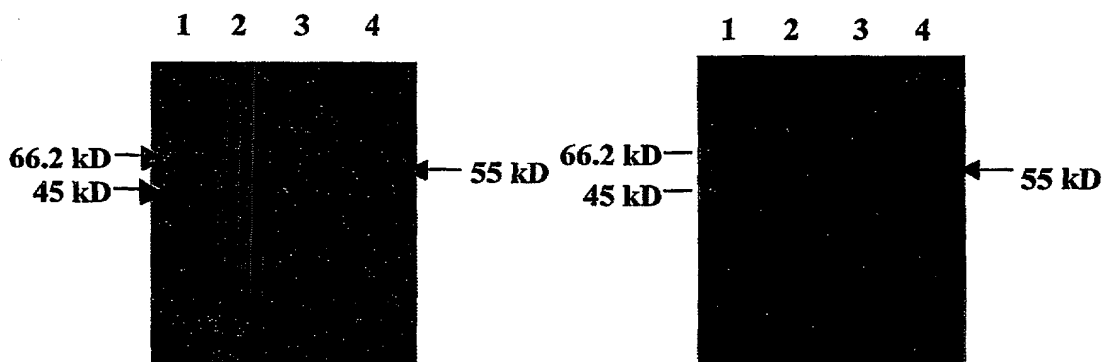

Sonicated samples


FIG. 4A

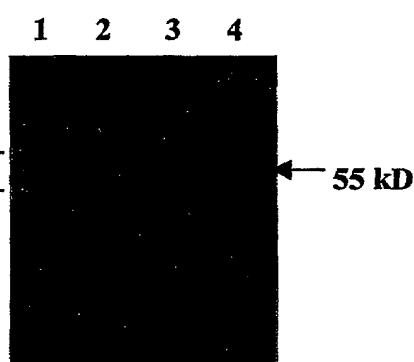


Boiled samples

FIG. 4B

4/8

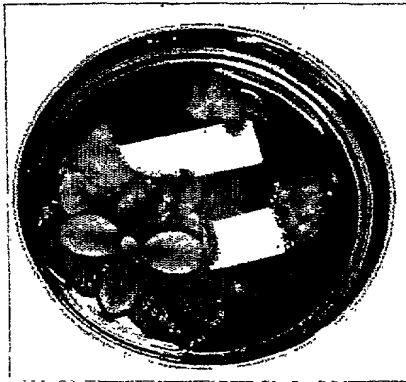

First round of selection

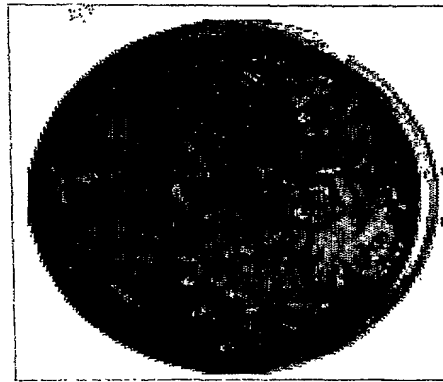

Second round of selection




Rooting medium



Potted transgenic Plant

FIG. 5

5/8

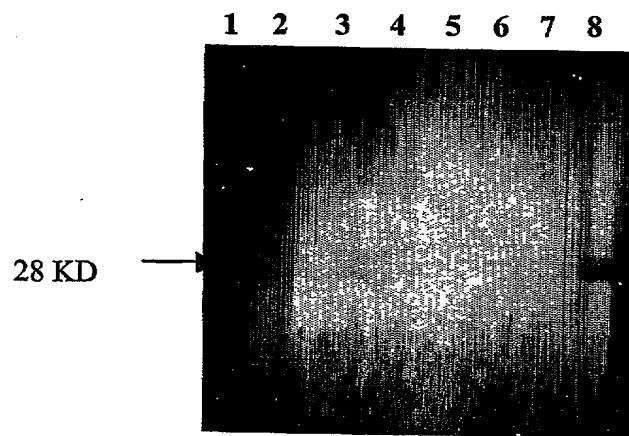

2x SDS Buffer
Without PMSF

FIG. 6A

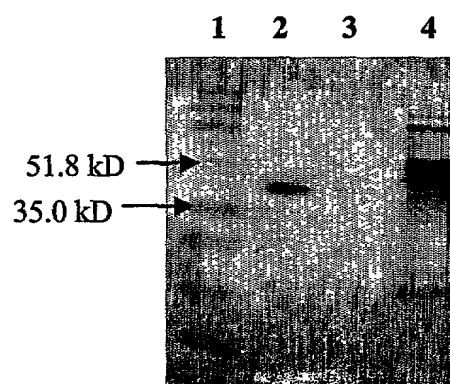


FIG. 6B

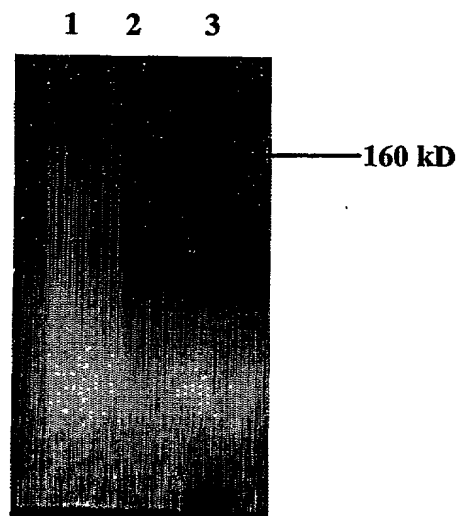


FIG. 7

09807721-041801

6/8

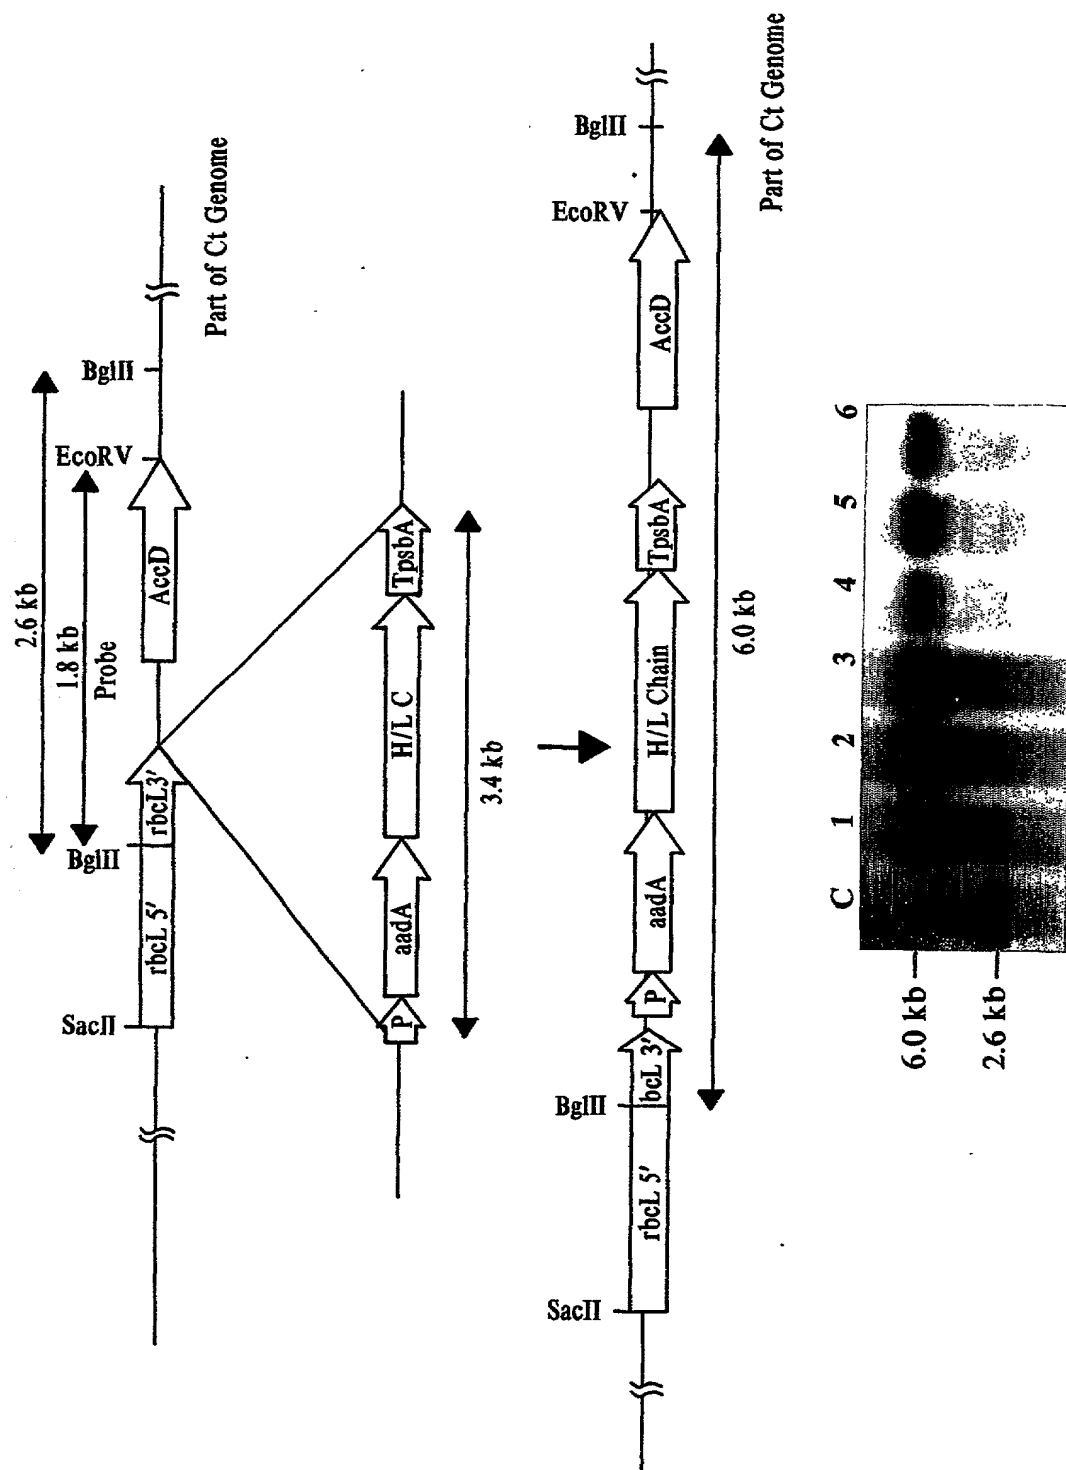


FIG. 8

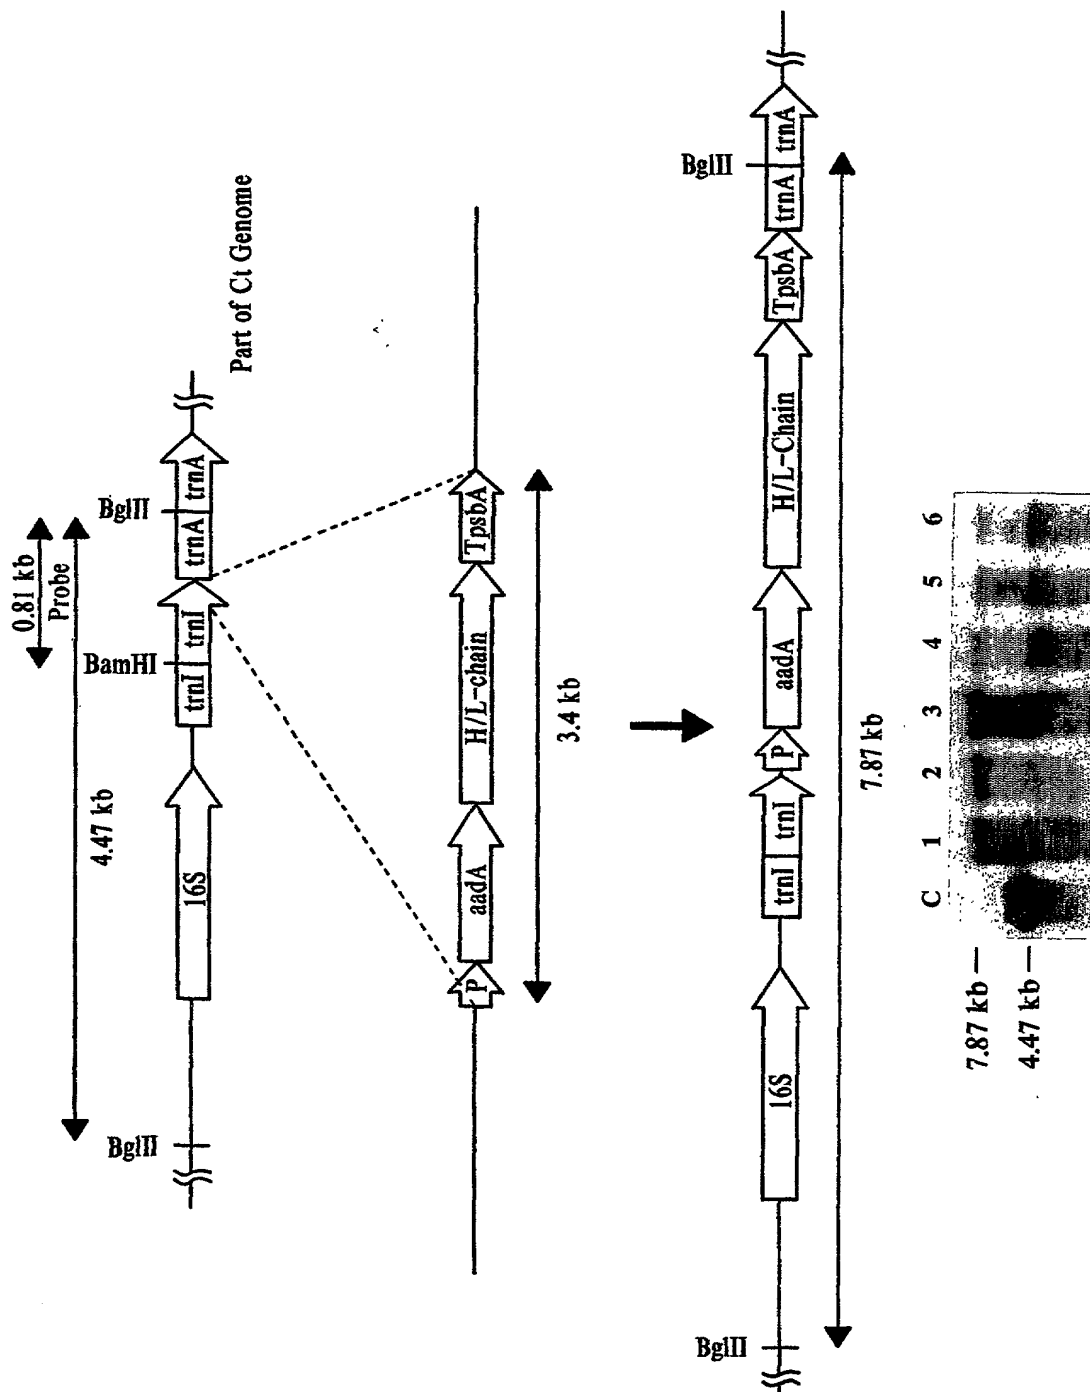


FIG. 9

FIG. 10A

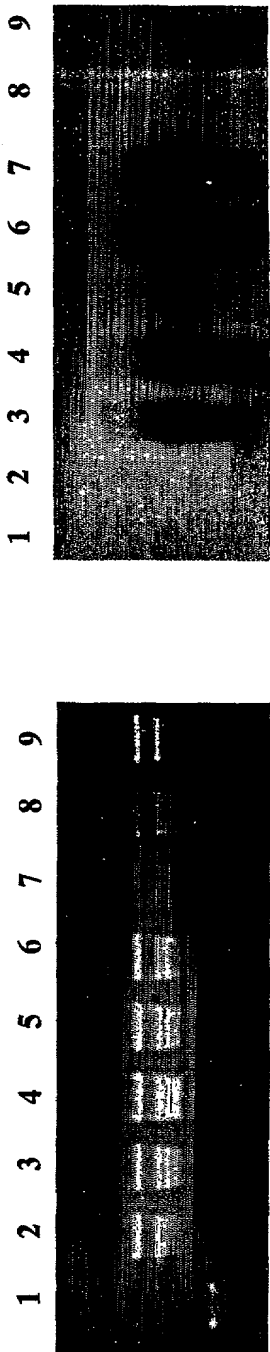


FIG. 10B



FIG. 11B

FIG. 10A

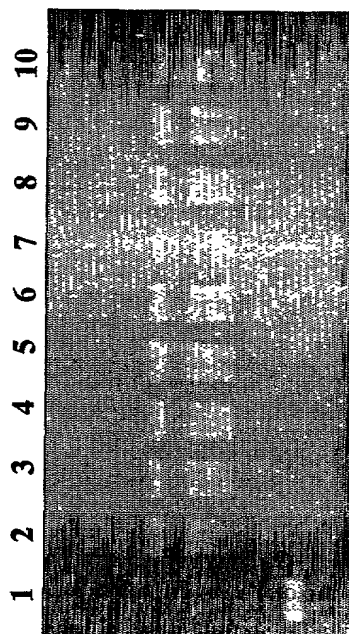


FIG. 11A